



2018-2020

MINIMUM REQUIRED Matting

At least 4 3/4"

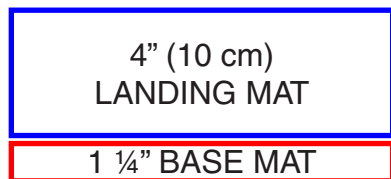

Or

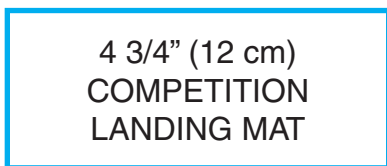

Or



(Base mat may be under or over any landing mat)

MAXIMUM ALLOWABLE Matting



any combination of matting not to exceed 19 inches (48 cm)

VAULT BOARD, FOLDED PANEL MAT OR MOUNT TRAINER MAT MAY BE USED FOR MOUNTING AND MAY BE PLACED ON

One or two 10 cm or 12 cm mats or a 20 cm CLM mat.

In addition, an up to 4" mat or sting mat may be added.

It may **not** be placed on an 8" skill cushion.

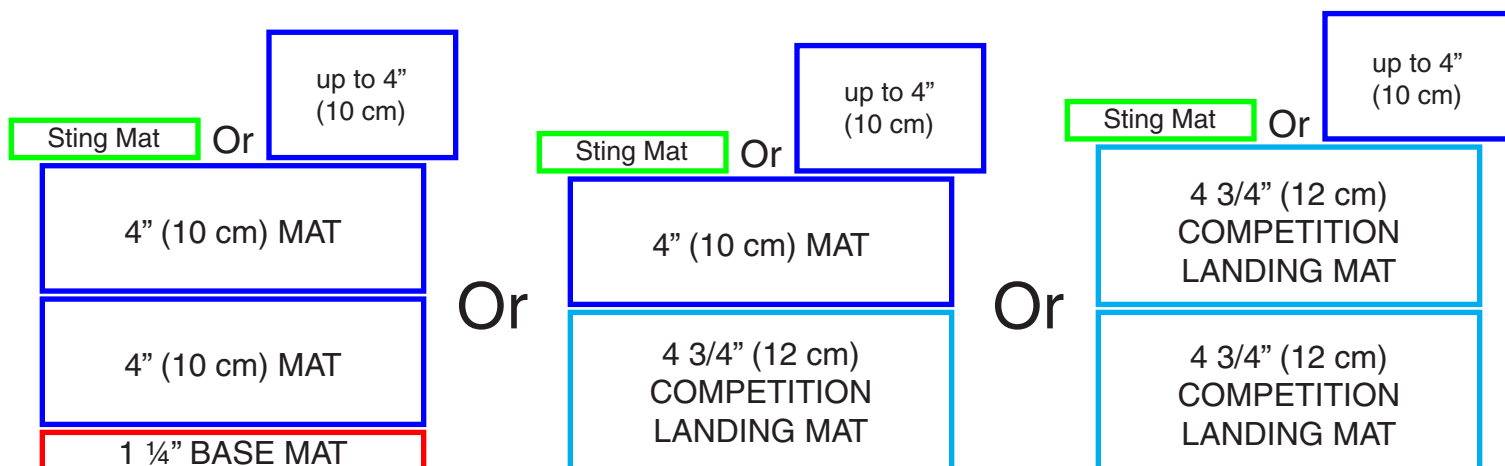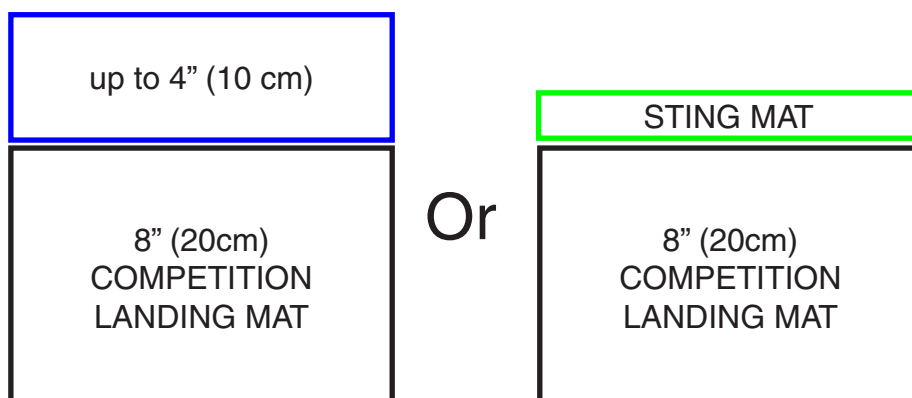

Floor Exercise—Up to 2 mats (up to 8") may be placed separately on the FX area for any element (only one per acro pass). A sting mat may be placed on top of or under an up to 8" skill cushion (including another sting mat) and the combination of the two mats will be counted as one additional mat. If either mat is removed, it may not be placed back on the floor.